



**US Army Corps  
of Engineers®**  
Engineer Research and  
Development Center

**ERDC**  
INNOVATIVE SOLUTIONS  
for a safer, better world

## **Ontology for Life-Cycle Modeling of Electrical Distribution Systems: Application of Model View Definition Attributes**

Kristine Fallon Associates, Inc.

June 2013

*11 E. Adams Street, Suite 1100  
Chicago, IL 60603*

Prepared under CRADA-07-CERL-02 under the supervision of

E. William East, Project Manager (CEERD-CF-N)

*Construction Engineering Research Laboratory  
US Army Engineer Research and Development Center  
2902 Newmark Drive  
Champaign, IL 61822*

**The US Army Engineer Research and Development Center (ERDC)** solves the nation's toughest engineering and environmental challenges. ERDC develops innovative solutions in civil and military engineering, geospatial sciences, water resources, and environmental sciences for the Army, the Department of Defense, civilian agencies, and our nation's public good. Find out more at [www.erdclibrary.usace.army.mil](http://www.erdclibrary.usace.army.mil).

To search for other technical reports published by ERDC, visit the ERDC online library at <http://acwc.sdp.sirsi.net/client/default>.

# **Ontology for Life-Cycle Modeling of Electrical Distribution Systems: Application of Model View Definition Attributes**

Kristine K. Fallon, Robert A. Feldman, Gregory Williams, and Omobolawa Fadojutimi

*Kristine Fallon Associates, Inc.  
11 E. Adams Street, Suite 1100  
Chicago, IL 60603*

Tim Chipman

*Constructivity.com, LLC  
2625 North Loop Drive  
Ames, Iowa 50010*

Final report

Approved for public release; distribution is unlimited.

Prepared for US Army Corps of Engineers  
Washington, DC 20314-1000

Under Cooperative Research and Development Agreement CRADA-07-CERL-02

Monitored by Construction Engineering Research Laboratory  
2902 Newmark Drive  
US Army Engineer Research and Development Center  
Champaign, IL 61822

## Abstract

Previous efforts by the US Army Engineer Research and Development Center, Construction Engineering Research Laboratory (ERDC-CERL) to develop a life-cycle building model have resulted in the definition of a “core” building information model that contains general information describing facility assets such as spaces and equipment. To describe how facility assets (i.e., components) function together, information about assemblies of assets and their connections must also be defined. The definitions of assets, assemblies, and connections for the various building-information domains are discipline-specific. Work documented in ERDC/CERL CR-13-2 identified the processes and tasks specifically associated with the design of building electrical systems and the information exchange requirements for every participant in the design. The findings were used to develop an information-exchange Model View Definition (MVD) for building electrical systems.

The objective of the current work was to document the steps needed to identify the electrical MVD attributes in three experimental building information models representing typical low-rise Army facilities, and to update the models. This work also validated the International Foundation Class (IFC) export function from the experimental models against the electrical MVD, and studied the requirements for creating computable open building models that can be utilized for the automated information exchanges.

**DISCLAIMER:** The contents of this report are not to be used for advertising, publication, or promotional purposes. Citation of trade names does not constitute an official endorsement or approval of the use of such commercial products. All product names and trademarks cited are the property of their respective owners. The findings of this report are not to be construed as an official Department of the Army position unless so designated by other authorized documents.

**DESTROY THIS REPORT WHEN NO LONGER NEEDED. DO NOT RETURN IT TO THE ORIGINATOR.**

# Contents

|  |           |
|--|-----------|
| <b>Abstract.....</b>   | <b>ii</b> |
| <b>Figures and Tables.....</b>   | <b>iv</b> |
| <b>Preface .....</b>   | <b>v</b>  |
| <b>Unit Conversion Factors.....</b>  | <b>vi</b> |
| <b>1 Introduction .....</b>  | <b>1</b>  |
| 1.1 Background.....  | 1         |
| 1.2 Objectives.....  | 2         |
| 1.3 Approach .....   | 2         |
| <b>2 Experimental Building Models .....</b>  | <b>3</b>  |
| 2.1 Overview.....  | 3         |
| 2.1 Determination of additional electrical system properties.....                                    | 4         |
| 2.2 Addition of the electrical system properties to the Revit<br>experimental building models .....  | 5         |
| 2.3.1 <i>Removing non-essential elements from the models</i> .....                                   | 5         |
| 2.3.2 <i>Subdividing types</i> .....   | 6         |
| 2.2.1 <i>Modeling additional electrical system elements</i> .....                                    | 6         |
| 2.2.2 <i>Adding additional properties to elements in the models</i> .....                            | 6         |
| 2.3.5 <i>Assigning default values</i> .....  | 7         |
| 2.3.6 <i>Updating project parameters</i> .....   | 7         |
| 2.3 Export of the models to IFC.....   | 9         |
| 2.3.1 <i>Revit IFC export</i> .....  | 9         |
| 2.3.2 <i>Special considerations regarding Revit IFC export</i> .....                                 | 10        |
| 2.4 Validation of the Revit 2013 IFC export .....  | 11        |
| <b>3 Conclusions and Recommendations.....</b>  | <b>15</b> |
| <b>References.....</b>   | <b>17</b> |
| <b>Appendix A: Electrical System Building Component Occurrences in the Revit<br/>    Models.....</b> | <b>18</b> |
| <b>Appendix B: Additional Electrical System Properties for Revit Families and<br/>    Model.....</b> | <b>21</b> |
| <b>Appendix C: Sample Validation Report .....</b>  | <b>27</b> |
| <b>Report Documentation Page</b>   |           |

## Figures and Tables

### Figures

|   |   |
|---|---|
| Figure 1. Parameter Properties dialog box showing the lamp efficiency property applied to lighting fixtures. .... | 7 |
| Figure 2. Parameter Properties dialog box showing the Building ID property applied to project information. ....   | 8 |
| Figure 3: Project Properties dialog box showing the building parameters.....                                      | 8 |

### Tables

|  |    |
|--|----|
| Table 1. Model statistics. ....  | 4  |
| Table 2. IFC export override parameter settings. ....                        | 9  |
| Table 3. Changed IfcExportAs and IfcExportType settings for Revit 2013 ..... | 10 |
| Table 4. IfcDoc validation report summary. ....                              | 13 |
| Table 5. IfcDoc MVD non-compliance items. ....                               | 14 |

## Preface

This study was conducted for the US Army Engineer Research and Development Center, Construction Engineering Research Laboratory (ERDC-CERL) and the National Institute of Building Sciences (NIBS) by Kristine Fallon Associates Inc., and Constructivity.com, LLC, under CRADA-07-CERL-02, “Cooperative Research and Development Agreement Between US Army Engineer Research and Development Center—Construction Engineering Laboratory and National Institute Of Building Sciences.” The CRADA supports Research, Development, Test, and Evaluation (RDT&E) Program Element 622784 T41, “Military Facilities Engineering Technology”; Project 157249, “Life-Cycle Model For Mission Ready Sustainable Facilities (LCM).” The ERDC-CERL project manager was Dr. E. William East (CEERD-CF-N), and the NIBS project manager was Dominique Fernandez.

The work was supervised and monitored by the Engineering Processes Branch (CF-N) of the Facilities Division (CF), ERDC-CERL. At the time of publication, Donald K. Hicks was Chief, CEERD-CF-N; L. Michael Golish was Chief, CEERD-CF; and Martin J. Savoie, CEERD-CV-ZT, was the Technical Director for Installations. The Deputy Director of ERDC-CERL was Dr. Kirankumar Topudurti and the Director was Dr. Ilker Adiguzel.

COL Kevin J. Wilson was the Commander of ERDC, and Dr. Jeffery P. Holland was the Director.

## Unit Conversion Factors

| Multiply              | By            | To Obtain     |
|-----------------------|---------------|---------------|
| feet                  | 0.3048        | meters        |
| gallons (U.S. liquid) | 3.785412 E-03 | cubic meters  |
| mils                  | 0.0254        | millimeters   |
| pounds (mass)         | 0.45359237    | kilograms     |
| square feet           | 0.09290304    | square meters |
| yards                 | 0.9144        | meters        |



# 1 Introduction

## 1.1 Background

Previous efforts by the US Army Engineer Research and Development Center, Construction Engineering Research Laboratory (ERDC-CERL) to develop a life-cycle building model have resulted in the definition of a “core” building information model that contains general information describing facility assets such as spaces and equipment (East, Love, and Nisbet 2010). To describe how facility assets (i.e., components) function together, information about assemblies of assets and their connections must also be defined. The definitions of assets, assemblies, and connections for the various building-information domains are discipline-specific. Taken together, studies of all essential building-information domains will create a unified framework for developing automatic design checks, ensuring construction compliance, improving operations and maintenance efficiency, and evaluating alternatives for redesign within completed facilities.

COBie (East 2007) was the first step in analyzing information exchanges in the life cycle of a building. Since March 2012, COBie has been part of the National BIM Standard—United States (NBIMS-US). COBie defines the format for providing information about building assets from the planning phase through design, construction, and operations. Properties of these assets may also be captured in the COBie data exchange format. The *COBie Guide*, a commentary on the COBie standard (public draft downloadable at link from [http://www.nibs.org/?page=bsa\\_cobieguide](http://www.nibs.org/?page=bsa_cobieguide)), does not prescribe how to model specific assemblies of components or how components and assemblies are connected. Those aspects of modeling and information exchange require a domain-specific ontology for every system needed to construct a functional building. Subsequent work led to the development of a Model View Design (MVD) for the design of electrical distribution systems in typical Army facilities. That MVD is documented in ERDC/CERL CR-13-2 (Chipman et al. 2013).

In order to provide a foundation for testing and validating research on building life-cycle topics, ERDC-CERL led the development of experimental core building information models for three common facility types widely used on Army installations: a Duplex Apartment, a Medical Clinic, and an Office Building (East 2012a). This report documents the applica-

tion of the electrical distribution system MVD to those experimental models as part of the effort toward creating formal specifications applicable to open-standards BIM at the coordinated design stage of construction.

## **1.2 Objectives**

The objective of this work was to document the steps needed to identify the electrical MVD attributes in the three experimental BIMs and update the models. This work also validated the International Foundation Class (IFC) export function from the experimental models against the MVD, and studied the requirements for creating computable open building models that can be utilized for the automated information exchanges.

## **1.3 Approach**

The present work applies the process flows and data exchanges requirements for the design of interior electrical distribution systems in typical Army facilities. These processes and exchange requirements were used to create a Model View Definition (MVD) procedures (see Chipman et al. 2013) defined by the International Organization for Standardization (ISO) and buildingSmart International (e.g., Hietanen 2008).

The electrical process flow and exchange requirements were applied to a simulated real-world situation to study how the information exchanges can be handled in COTS BIM software using the three experimental models noted above. These “core” BIMs represent typical low-rise facilities commonly built on Army installations. Electrical equipment and systems were updated using commercial off-the-shelf (COTS) BIM software and a native common object library developed in that software. Coordinated IFC models were then generated using the COTS IFC export capability.

The models act as a test bed for the MVD and the COTS tools available at the time the work was performed. While the results will change with time, as software is updated to accommodate this and potentially other new MVDs, the procedures described here can be used by others to evaluate their software and design processes.

## 2 Experimental Building Models

### 2.1 Overview

This chapter documents the procedure followed for the design-phase modeling and IFC export of electrical systems equipment found in three typical Army facilities: a Duplex Apartment, an Office Building and a Clinic. The goal of this process is to produce model files in the native COTS BIM-authoring software and IFC formats for the information exchange of electrical system design information. The three example models produced by this process can serve as reference data for future experimentation by ERDC and testing by software developers and end users.

The starting points for the modeling were previously developed architectural and mechanical/electrical/plumbing (MEP) experimental models (East 2012a). These models were initially developed using Revit 2011, which was current at the time the models were created. In the present work, Revit 2013, Update Release 2, build 20121003\_2115(x64), was used. As Revit versions are not backward compatible, the models produced for the current project cannot be used within Revit 2011.

It should be noted at the outset that this MVD is based on IFC4, which had not been officially approved at the time this work was undertaken. As stated in Chipman et al. 2013 (p 61),

While most product geometry information was already well-defined within IFC version 2x3 and implemented by many vendors, there were many concepts that required some of the lesser-supported IFC data structures and some that required the expanded MEP scope in IFC version 4 to achieve adequate levels of detail... While realizing that many of these concepts were not supported by existing COTS software, the MVD has been defined to allow partial compliance for now, but with allowances to later relax or replace some requirements after testing models produced by existing software .

Therefore, one cannot fault Revit 2013 (the selected COTS software, which was designed to use IFC2x3) for not handling the IFC4 concepts. Indeed,

as noted below (section 2.6), the tests used to validate conformance to the MVD were relaxed to take account of the IFC4 concepts.

The Revit models were edited to remove non-electrical system interior elements so that the tests of the electrical system MVD would not contain extraneous information. Families and groups not related to testing the electrical system MVD were deleted from the model.

The following sections describe creating the Revit 2013 electrical system design models and exporting these models to IFC. Details on the modeling of each building type are given below in separate sections.

Table 1 provides statistical information for each of the three models.

**Table 1. Model statistics.**

| Model Statistics  | Duplex      | Office       | Clinic       |
|-------------------|-------------|--------------|--------------|
| Native file size  | 14.5MB      | 16MB         | 18.6MB       |
| IFC file size     | 1.6MB       | 6.3MB        | 11.6MB       |
| Building Area     | 3,372 sq ft | 40,053 sq ft | 49,571 sq ft |
| No. of Spaces     | 21          | 99           | 266          |
| No. of types      | 15          | 14           | 57           |
| No. of Components | 103         | 887          | 2,118        |

## **2.1 Determination of additional electrical system properties**

In order to meet the requirements of the Electrical System MVD, additional properties must be added to those already on the electrical system elements in the experimental Revit models. That additional properties are needed is not a fault in the software used or the original models – it simply underscores the notion that, as new information exchanges are defined, additional properties can be added to the models to accommodate the new uses that the new MVD provides.

To determine what properties were needed:

1. Using the schedules in the Revit models, a spreadsheet listing the electrical system element types was created and the occurrence of each type in the three models was noted (Appendix A). For some elements,

- such as the M\_Elevator-Hydraulic, the IFC classification was assigned to reflect the electrical system components of the element.
2. A list of the property sets and properties for these element types was extracted from the MVD and added to the spreadsheet for each type.
  3. The list of properties needed by the Electrical System MVD was compared to the list of properties already in the Revit models to create a list of the properties that needed to be added to the element types in the model. This list is shown in Appendix B.

The time needed to identify the needed properties will depend on the complexity of the model, but can take a day or two.

## **2.2 Addition of the electrical system properties to the Revit experimental building models**

The base architectural and MEP Revit models, which are documented in ERDC/CERL CR-11-2 (Johnson and Fallon 2011), were downloaded from buildingSmartAlliance (East 2012a).

The following steps were followed to update and expand these models:

1. Non-electrical system elements were removed from the models so that the IFC export would include only the target electrical system elements and the building architectural elements necessary to define the floors, rooms and spaces.
2. Some existing types were subdivided into multiple types.
3. Additional electrical system elements were added as needed. Since the electrical system models in these buildings are relatively completely developed, so little additional modeling was needed.
4. Additional properties were added to the electrical system elements as needed. This process can take a day or two, depending on the complexity of the model. It is recommended that a copy of the original model be retained, since if errors are made, it is often easier to revert to the original model than it is to remove the incorrect properties.
5. Default values were assigned to element parameters.
6. Project parameters were updated.

### **2.3.1 Removing non-essential elements from the models**

Building interior features, such as furniture, casework, plumbing and heating elements and piping, were deleted from the model. Plumbing and

heating elements that have electrical connections (such as the water heaters and roof-top ventilators) were retained.

### **2.3.2 Subdividing types**

The original experimental BIMs combined some related fixture types into a single Revit element type. For example, in the Clinic model, a total of only 7 light fixture types were used to represent what should have been 42 separate fixture types. The original Revit families were edited to include the actual number of types required. The COBie spreadsheets for the three buildings (East 2012a) were used to identify the separate fixture types and their locations in the model, which were updated accordingly.

#### **2.2.1 Modeling additional electrical system elements**

There were no additional electrical system elements added to the experimental BIMs.

#### **2.2.2 Adding additional properties to elements in the models**


In order to include the electrical properties that were identified in Section 1.2 on the families in the building model, it was necessary to directly update the families in Revit with the new parameters.

The following procedure was used to add the additional parameters to the models:

1. The Revit MEP model for the Duplex Apartment—Duplex\_MEP.rvt — was opened in Revit 2013.
2. New Revit Shared Parameters for each of the new electrical properties were added to the COBieSharedParameters.txt file using the Revit Manage tab > Shared Parameters command. The resulting shared parameter file was saved as COBieSharedParameters - Ontologies MVD-Electrical.txt.
3. The new Shared Parameters were added to selected element categories using a proprietary custom add-in program. (Steps 2 and 3 can also be done using the Revit Manage tab > Project Parameters > Add command.)
4. A copy was made of the existing electrical schedules in the Duplex Apartment Model file, re-named where necessary based on the corresponding Revit Category and updated to include the new parameters.

5. The new parameters were edited in the Schedule Properties dialog box to apply the parameters to the appropriate element categories in the model (Figure 1).
6. For the other models and the Revit Experimental BIM template (.RTE) files, each file was opened in Revit 2013 and the electrical schedules created were copied into it from the first model. Copying the schedules into the model applies the shared parameters to the building elements in the model.

Figure 1. Parameter Properties dialog box showing the lamp efficiency property applied to lighting fixtures.

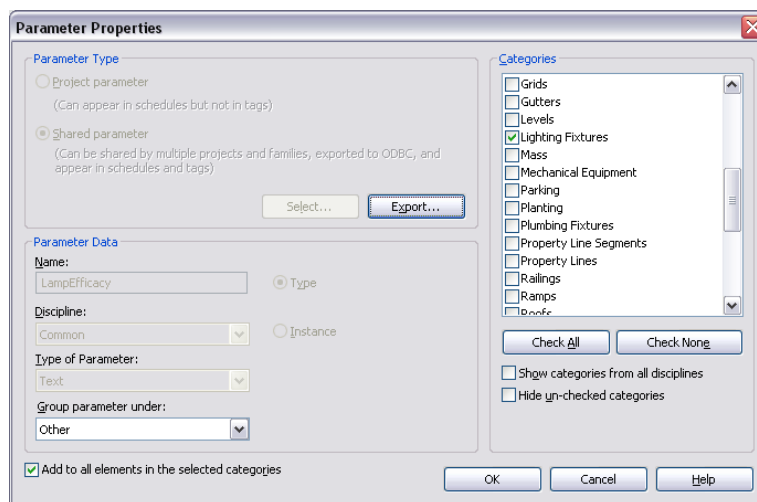


### 2.3.5 Assigning default values

Revit does not export to IFC custom parameters that do not have assigned values. Therefore, in order to be able to export all of the additional electrical parameters to IFC, default values (such as 0, UNSET, or N/A) were set using a proprietary custom add-in program. (Values could also have been set by editing the Revit schedules of the electrical system elements.)

### 2.3.6 Updating project parameters


The procedure for adding additional properties to the overall project were similar to the steps outlined in section 2.3.4, Adding Additional Properties to Elements in the Models. All shared parameters associated with the overall project were added as Project Parameters and associated with the Project Information category (see Figure 2).

Figure 2. Parameter Properties dialog box showing the Building ID property applied to project information.

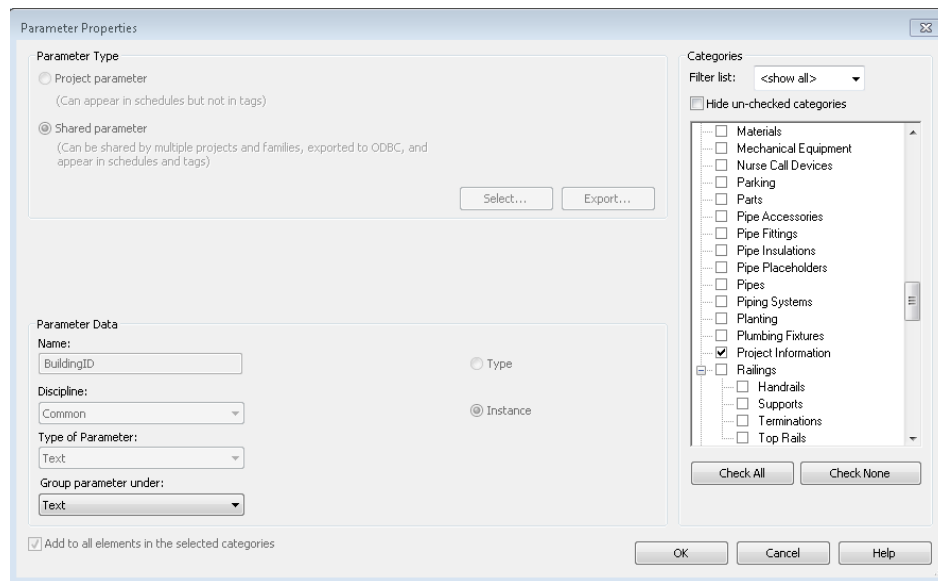

This category cannot be scheduled. Updating these parameters with the correct values was completed by navigating to the project properties dialog box (**Revit Manage tab > Project Information**) then typing the values in the fields provided.

Figure 3: Project Properties dialog box showing the building parameters.

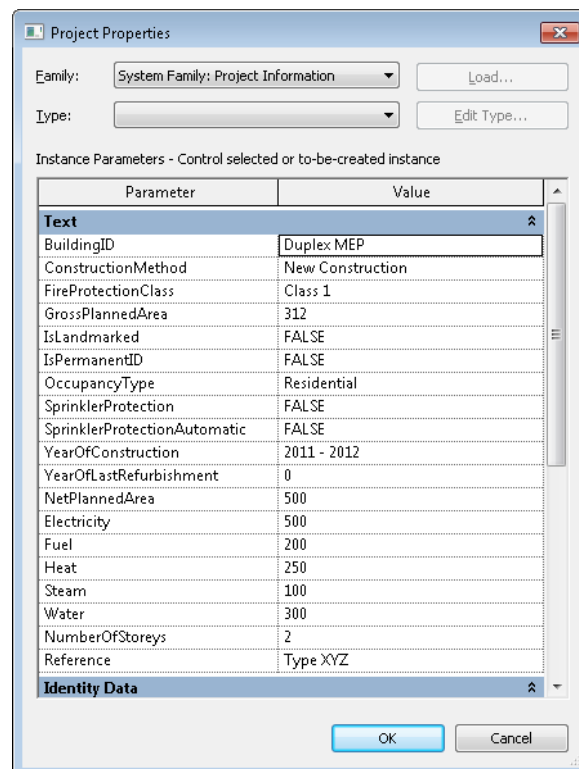



## 2.3 Export of the models to IFC

Once the building models had been edited to expand the electrical system model and remove extraneous elements, new properties added to the models and applied to the building elements in the models and default values assigned, the models were ready to export to IFC files.

### 2.3.1 Revit IFC export

The basic procedures for successfully exporting the Revit model to IFC are outlined in ERDC/CERL CR-11-2 9 (Johnson and Fallon 2011). Because of changes in Revit's IFC export between the 2011 and 2013 releases, some of the values of the `IfcExportAs` and `IfcExportType` override parameters needed to be changed. (The Revit 2011 settings from the original Table 2-15 from ERDC/CERL CR-11-2 are reproduced here for electrical elements as Table 2. See Table 3 for the changed settings for the Revit 2013.) All three of the elements in Table 3 had their value for the `IfcExportAs` parameter set to `IfcElectricDistributionPoint` for Revit 2011.

Table 2. IFC export override parameter settings.

| Revit Family  | IfcExportAs                  | IfcExportType      |
|---|------------------------------|--------------------|
| M_Air Handling Unit - Split System - Horizontal.rfa         | IfcFanType                   | CENTRIFUGALAIRFOIL |
| M_Air Handling Unit - Vertical Packaged - DX - 21-35 kW.rfa | IfcFanType                   | CENTRIFUGALAIRFOIL |
| M_Centrifugal Fan - Rooftop - Upblast.rfa                   | IfcFanType                   | CENTRIFUGALAIRFOIL |
| M_Duplex Receptacle.rfa                                     | IfcOutletType                | POWEROUTLET        |
| M_Fire Alarm Control Panel.rfa                              | IfcElectricDistributionPoint | CONTROLPANEL       |
| M_Hot Water Boiler - 59-440 kW.rfa                          | IfcBoilerType                | WATER              |
| M_Inline Pump - Circulator.rfa                              | IfcPumpType                  | CIRCULATOR         |
| M_Lighting and Appliance Panelboard - 208V MLO.rfa          | IfcElectricDistributionPoint | DISTRIBUTIONBOARD  |
| M_Microwave.rfa   | IfcElectricApplianceType     | MICROWAVE          |
| M_Range.rfa   | IfcElectricApplianceType     | ELECTRICCOOKER     |
| M_Refrigerator.rfa  | IfcElectricApplianceType     | FRIDGE_FREEZER     |
| M_Screw Chiller - Air Cooled - 1406-1758 kW.rfa             | IfcChillerType               | AIRCOOL            |
| M_Screw Chiller - Air Cooled - 281-1231 kW.rfa              | IfcChillerType               | AIRCOOL            |
| M_Telephone Terminal Board.rfa                              | IfcElectricDistributionPoint | DISTRIBUTIONBOARD  |
| M_Thermostat.rfa  | IfcControllerType            | TWOPOSITION        |
| M_Transformer Switchboard.rfa                               | IfcTransformerType           | VOLTAGE            |
| M_VAV Unit - Single Duct.rfa                                | IfcFanType                   | NOTDEFINED         |
| M_Water Heater.rfa  | IfcTankType                  | PREFORMED          |

Table 3. Changed IfcExportAs and IfcExportType settings for Revit 2013

| Revit Family                        | IfcExportAs              | IfcExportType     |
|-------------------------------------|--------------------------|-------------------|
| M_Fire AlarmControl Panel           | IfcControllerPanel       | ALARMPANEL        |
| M_Lighting and Appliance Panelboard | IfcProtectiveDeviceType  | DISTRIBUTIONBOARD |
| M_Telephone Terminal Board          | IfcElectricApplianceType | FLOWTERMINAL      |

The Revit model was exported to IFC using the IFC-exportlayers.txt file created for the Experimental BIM project (East 2012a). The IFC-exportlayers.txt file provides additional Revit-to-IFC mappings to enable correct export of the Revit elements and properties to IFC (see the Experimental BIM report for more details).

### 2.3.2 Special considerations regarding Revit IFC export

Several special considerations that apply to Revit's IFC export functionality affect the completeness of the IFC file and its validation against the MVD. It should be noted that since the version of Revit 2013 selected for this project (20121003\_2115 [x64]) was released, changes have been made to the open source Revit IFC export code. Users who wish to use the latest Revit IFC export code should get the latest version of the open source Revit exporter plug-in, either from SourceForge (<http://sourceforge.net/projects/ifcexporter/files/2013>) or from the Autodesk Exchange App Store (<http://apps.exchange.autodesk.com/RVT/Home/Index>).

Revit MEP elements contain connector sub-elements that identify the ports and flow direction. As of the version of Revit 2013 used in this study, however, Revit does not export electrical ports. The IFC export source code (ConnectorExporter.cs, line 46 and line 61, version 2.4.0.0 of the source code, dated 2012-10-23, downloaded from <http://sourceforge.net/projects/ifcexporter/>) states in two comments that the export of connection ports "Works only for HVAC and Piping for now."

Property values that should be numeric but that have a unit text, such as '208 V' for 208 volts, get incorrectly converted in the IFC export. For example, '208 V' exports as '2238.89'. This is a known issue in Revit. The Revit API GetParameter function returns values in a mixture of imperial units for length and metric units for everything else. So volts, which can be expressed as  $(\text{kg} * \text{m}^2) / (\text{A} * \text{s}^3)$ , get returned as  $(\text{kg} * \text{ft}^2) / (\text{A} * \text{s}^3)$ . Note that  $2238.89/208$  is approximately 10.76, or in other words 1 m<sup>2</sup>/1 ft<sup>2</sup> (Valdez 2012). This problem has reportedly been fixed in the Open Source code.

At the time Revit 2013 was released, IFC4 had not been approved, so it is not supported. Because the Electrical System MVD is written to take advantage of IFC4, adjustments were made to the validation tests to account for the fact that Revit exports to IFC 2x3.

## **2.4 Validation of the Revit 2013 IFC export**

The exported IFC files for the three BIMs were checked against the Electrical System MVD using the ifcDoc tool (downloaded from <http://www.buildingsmart-tech.org/specifications/specification-tools/ifcdoc-tool>). IfcDoc is a Microsoft Windows program that automates IFC documentation generation for both baseline IFC documentation as well as Model View Definitions. It supports generating boilerplate text from templates, hyperlinks, EXPRESS definitions, figures, tables, contents, and indices. It can also import MVD-XML and file and validate IFC files for conformance to that MVD. Additional information on our validation methodology is presented in Appendix C. Additional information on using the ifcDoc tool can be found at <http://www.buildingsmart-tech.org/specifications/specification-tools/ifcdoc-tool/ifcdoc-help-page>.

Because the Electrical System MVD was based on IFC4, which was unofficial at the time this work was undertaken, Revit 2013 does not support IFC4 concepts. Adjustments to the requirements of the MVD were made in ifcDoc to make some IFC4 concepts optional. Other modifications were made to simplify the report format and combine similar error reports into single line items.

As model view definitions have historically been defined by their documentation only (no computer interpretable rules), validation has typically been a manual process requiring human interpretation of documentation and authoring of programming code to test IFC files.

BuildingSmart International established the mvdXML format as a way to automate the validation process such that future model view definitions may be validated without custom programming. The Electrical System model view definition presented here was one of the first to leverage mvdXML. At the time this MVD was authored, mvdXML 1.0 had been finalized and approved, but validation tools were not readily available.

The Global Testing Documentation Server tool ([gtds.buildingsmart.com](http://gtds.buildingsmart.com); registration required) was scheduled to support mvdXML validation at the

time of IFC4 final release (previously slated for July 2012), however the IFC release schedule was extended to accommodate ISO approval, with the result that the mvdXML validation tools were not yet integrated into GTDS as of late 2012, when the work reported here was completed.

The Open Source Building Information Modelserver ([bimserver.org](http://bimserver.org)) also indicated intentions of supporting mvdXML validation, yet that support was delayed due to resource availability. As of February 2013, the researchers have been in contact with a developer actively working on mvdXML integration.

While mvdXML support from either of these tools is expected in the near future, the project timeline necessitated validation tools in late Fall of 2012. To accommodate this schedule, several alternatives were considered: (a) exclude validation efforts; (b) postpone validation until tools are available; or (c) invest resources out-of-pocket in creating such tools. The latter option was selected, and the team worked with buildingSmart International to expand the IfcDoc tool to support integrated validation of model view definitions. To help streamline other efforts, the utility was adapted to support integration with server tools such as the above.

The report in Appendix C (Table C-3) was generated by the IfcDoc validation tool, an open-source utility available at [buildingsmart-tech.org/mvd](http://buildingsmart-tech.org/mvd). The report is organized by IFC entity, with concepts underneath each entity. Columns are shown for on the right for each exchange, identified by number (see Table C-1). The symbols in the column indicate the status of each test (see Table C-2).

Some of the concepts tested relied on IFC4. The team attempted to leverage IFC2x3 where possible but it lacked the detail for various concepts deemed critical for MEP systems. Ultimately, the goal of these model view definitions is to provide the necessary information to actually build a building. For example, port typing in particular is necessary to understand how equipment is connected, and to analyze systems for required capacity and conformance to building code; IFC4 supports identifying port types and system types unambiguously. Another such critical concept was classification. While that is also possible in IFC2x3, IFC4 provides an enforceable syntax to ensure that classifications are interoperable across files. Additionally, there were some specific IFC4 concepts leveraged for certain exchanges, such as occupancy schedules, projected energy usage, and re-

source allocations. To distinguish between IFC2x3 and IFC4 concepts, each IFC4-dependent concept is noted in Table C-3 and overall statistics were calculated for both IFC2x3 and IFC4.

It was found that software already on the market in 2012 was able to produce files that were in 100% conformance with some of the exchanges for IFC2x3. The more advanced concepts that failed the validation provide room to push the industry forward toward greater detail and better interoperability.

An overall summary of the MVD Validation report is provided below in Table 4 and a detailed summary in Table C-4. The percentages of non-compliant items are also provided and associated with the possible cause. Appendix C, Table C-3, presents the validation results broken down by the specific exchange and Table C-4 presents a summary of the numbers. The summary in Table 4 identifies the applicable concepts, number of passing concepts, and the percentage of concepts that passed the validation check, based on all of the object instances in the model. Table C-3 shows the validation results based on each separate information exchange and presents percentages passing based on the number of rules checked, not the number of instances.

**Table 4. IfcDoc validation report summary.**

| <b>Electrical Systems MVD Validation</b>  | <b>Duplex</b> | <b>Office</b> | <b>Clinic</b> |
|---|---------------|---------------|---------------|
| Tests Applicable  | 214           | 214           | 214           |
| Tests Passing All Exchanges   | 172           | 170           | 172           |
| Optional Tests Failing Any Exchange (number)                                      | 22            | 22            | 22            |
| Optional Tests Failing Any Exchange (percent)                                     | 10.3%         | 10.3%         | 10.3%         |
| Mandatory Tests Failing Any Exchange (number)                                     | 20            | 22            | 20            |
| Mandatory Tests Failing Any Exchange (percent)                                    | 9.3%          | 10.3%         | 9.3%          |
| Overall Percent of Tests Passing (IFC4)   | 97-99%        | 97-99%        | 97-99%        |
| Overall Percent of Tests Passing (IFC2x3)   | 97-100%       | 97-100%       | 97-100%       |
| <b>Causes of Non-Compliance, as a percentage of total non-compliant concepts:</b> |               |               |               |
| IFC4  | 61%           | 55%           | 56%           |
| Revit IFC Export hard-coded to null   | 17%           | 15%           | 16%           |
| Values not assigned in the code   | 22%           | 30%           | 28%           |

As indicated in Table 4, about 10% of the 214 tests failed for at least one optional exchange for the three buildings; about 9% failed at least one

mandatory test for the Duplex Apartment and Clinic and about 10% for the Office Building. The overall failure rate for all tests, looked at for each exchange separately, ranged from 1% to 3% for IFC4 tests and from 0% to 3% for IFC2x3 tests. Not unexpectedly, none of the 29 exchanges passed all of the IFC4-related tests, but 19 of the 29 exchanges passed all of the IFC2x3 tests.

Overall, the Entities (Item), Concepts (Sub-Items), and Problems related to the possible Causes of non-compliance are listed below in Table 5. Refer to Chapter 3 of the companion MVD report (Chipman et al. 2013) for discussion of Entities and Concepts as related to MVDs.

**Table 5. IfcDoc MVD non-compliance items.**

| Item                       | Sub-Item                | Problem   | Cause   |
|----------------------------|-------------------------|---|---|
| IfcProject                 | Project Context         | 'Plan' context is not defined for 2D layout   | Revit puts the information in the 'Annotation' context rather than the 'Plan' context |
| IfcSite                    | Site Location           | Physical address is needed for determining applicable building codes                                  | Hard-coded to null in Revit IFC export  |
| IfcBuilding                | Classification          | OmniClass address needed for classifying building to determine code requirements                      | IFC4  |
| IfcBuilding                | Building Location       | Elevations needed to determine utility connectivity   | Hard-coded to null in Revit IFC export  |
| IfcSpace                   | Classification          | OmniClass address needed for classifying space to determine designed electrical usage per square foot | IFC4  |
| IfcLightFixtureType        | Property Sets for Types | Manufacturer type information necessary to identify, order, and price products                        | Variable created in Revit IFC export code, but no values are assigned                 |
| IfcDistributionPort        | Property Sets           | Cable property sets required to size, order, and price cabling  | IFC4.<br>Electrical ports not exported by Revit                                       |
| IfcPumpType                | Property Sets for Types | Manufacturer type information necessary to identify, order, and price products                        | Variable created in Revit IFC export code, but no values are assigned                 |
| IfcCableCarrierFittingType | Property Sets for Types | Manufacturer type information necessary to identify, order, and price products                        | Variable created in Revit IFC export code, but no values are assigned                 |
| IfcCableCarrierSegmentType | Property Sets for Types | Manufacturer type information necessary to identify, order, and price products                        | Variable created in Revit IFC export code, but no values are assigned                 |
| IfcCableCarrierSegmentType | Material Profile Set    | Required to determine capacity, placement, sizing, and interference                                   | IFC4  |
| IfcOutletType              | Property Sets for Types | Manufacturer type information necessary to identify, order, and price products                        | Variable created in Revit IFC export code, but no values are assigned                 |
| IfcProtectiveDeviceType    | Property Sets for Types | Manufacturer type information necessary to identify, order, and price products                        | Variable created in Revit IFC export code, but no values are assigned                 |

### 3 Conclusions and Recommendations

While the subject matter experts interviewed in the first stage of this project (Chipman et al. 2013) showed a diversity of project delivery methods and specific workflows, it was possible to define role-based information exchanges that were broadly applicable. The information exchanges identified in these workflows established the basis for developing the Electrical Systems MVD. Although at the time of this report IFC2x3 is the currently adopted standard, the Electrical Systems MVD was written for IFC4. IFC4 was used due to its expanded capabilities for describing electrical schemas. The final version of IFC4 is scheduled to be released in 2013 and it is anticipated that the issues identified in this report related to IFC4 will be addressed once IFC4 is officially released and adopted by software vendors.

Using the Electrical Systems MVD, additional required properties were identified for the electrical elements in the BIMs and add these properties to the models. Based on the results received after updating each of the BIMs with the additional MVD attributes, converting the BIMs to IFC, and analyzing the data utilizing the ifcDoc tool, it can be concluded that the current COTS version of Revit 2013, Update 2 is capable of capturing and managing the necessary information within the BIMs.

Although the Electrical Systems MVD is new and still preliminary, and thus not supported by COTS software, and Revit does not claim to have extensive IFC 2X3 export support for MEP systems, the validation reports generated by the ifcDoc tool indicated that more than half of the included concepts were successfully exported to IFC. The validation reports indicated that the three main causes for non-compliance were:

- concepts and properties introduced in IFC4
- property values that are hard-coded to null in Revit IFC export
- property values are not assigned in the Revit IFC export code.

In the process of conducting this research, it has become clear that describing and maintaining the systems and connections between elements in the BIM is essential to extracting useful data for the information exchanges described by this MVD. This requirement has implications both

for the way some electrical elements are defined in the COTS software and for the way a typical BIM design project subdivides the model.

- Some BIM families (e.g., a water heater) can belong to different systems and even different disciplines and might be better modeled if broken into separate components. For the water heater, this means that the electrical heating element is part of an electrical supply system, while the water input connects to a cold water system and the output feeds the hot water system.
- The common method of subdividing large projects by floors or even by parts of floors can sever the system connections between elements in different parts of the model. Without these system connections, some of the information needed for the information exchanges in the MVD is lost. New ways of subdividing large models are needed that will preserve both the system and the contextual information.

The modeling work described in this report demonstrates that it is possible, recognizing some limitations in the current software, to use the new MVD to add properties to the BIM and extract that information to IFC, where it can be used for further analyses. If future software releases address these issues, the BIMs will have the ability to achieve greater interoperability by providing the additional information that teams require during the design phase.

Looking to the future, although the IFC2x3 Coordination View has been sufficient for BIM use in the industry to date, it is time for vendors to support the entire IFC data model more fully. In that way, the ability of the software to handle new MVDs would be increased. Further, the software development tools and techniques accompanying IFC4, particularly mvdXML, make the incorporation of new MVDs much easier for software vendors.

In order to reduce the problems of identifying additional properties that need to be applied to product categories, methods are needed to align proprietary types, hierarchies and inheritance with the IFC data model. These problems would also be reduced and user experience and predictability of outcome would be enhanced, if the BIM content included in authoring software products and provided by manufacturers contained the relevant IFC property sets.



## References

- Chipman, Tim, Kristine K. Fallon, Robert A. Feldman, Gregory Williams, and Omobolawa Fadojutimi, 2013. *Ontology for Life-Cycle Modeling of Electrical Distribution Systems: Model View Definition*. ERDC/CERL CR-13-2. Champaign, IL: US Army Engineer Research and Development Center, Construction Engineering Research Laboratory.
- East, E.W. 2007. Construction Operations Building Information Exchange (COBIE), Requirements Definition and Pilot Implementation Standard, ERDC/CERL TR-07-30, US Army Corps of Engineers, [http://www.wbdg.org/pdfs/erdc\\_cerl\\_tr0730.pdf](http://www.wbdg.org/pdfs/erdc_cerl_tr0730.pdf) . August 2007.
- East, E. W. 2012a. "Common Building Information Model Files," buildingSMART alliance, National Institute of building Sciences, Washington, DC. <http://buildingsmartalliance.org/index.php/projects/commonbimfiles/>, accessed 11 October 2012.
- East, E.W. 2012b. Construction Operations Building Information Exchange (COBie), <http://www.wbdg.org/resources/cobie.php>, accessed 6 August 2012.
- East, E.W. 2012c. Equipment Layout information exchange (ELie). Available at: <http://www.buildingsmartalliance.org/index.php/projects/activeprojects/114>, accessed 17 August 2012.
- East, E.W. 2012d. "Electrical System information exchange (Sparkie)," <http://www.buildingsmartalliance.org/index.php/projects/activeprojects/178> 17 August 2012.
- East, E.W., Danielle Love and Nicholas Nisbet, 2010. A Life-Cycle Model for Contracted Information Exchange. Proceedings of the CIB W78 2010: 27th International Conference –Cairo, Egypt, 16-18 November 2010.
- Hietanen, J. 2008. IFC Model View Definition Format. Available at: [http://www.iai-tech.org/downloads/accompanying-documents/formats/MVD\\_Format\\_V2\\_Proposal\\_080128.pdf](http://www.iai-tech.org/downloads/accompanying-documents/formats/MVD_Format_V2_Proposal_080128.pdf)
- Nisbet, Nicholas, Dave McKay and Bill East. June 2011. *Water Usage System Information Exchange*. Unpublished task closeout report. Champaign, IL: US Army Engineer Research and Development Center, Construction Engineering Research Laboratory.
- Valdez, Angel. 2012. Discussion post in <http://sourceforge.net/projects/ifcexporter/discussion/general/thread/d8171b6e>, accessed 23 October 2012.

## **Appendix A: Electrical System Building Component Occurrences in the Revit Models**

Table A1. Electrical system building component occurrences in the Revit models.

| --- COMPONENT ---  |                   | TYPE                     | BUILDING OCCURRENCE |        |        |
|--|-------------------|--------------------------|---------------------|--------|--------|
| FAMILY:TYPE  | IFC               | IFC                      | Duplex              | Clinic | Office |
| M_Plain Recessed Lighting Fixture:600x1200 - 120                   | IfcFlowTerminal   | IfcLightFixtureType      |                     |        | *      |
| M_Plain Recessed Lighting Fixture:600x600 - 120                    | IfcFlowTerminal   | IfcLightFixtureType      |                     |        | *      |
| M_Pendant Light - Linear - 2 Lamp:1200mm - 120V                    | IfcFlowTerminal   | IfcLightFixtureType      |                     | *      | *      |
| M_Pendant Light - Linear - 2 Lamp:2400mm - 120V                    | IfcFlowTerminal   | IfcLightFixtureType      |                     | *      | *      |
| M_Troffer Light - Parabolic Rectangular:0600x1200mm(2 Lamp) - 120V | IfcFlowTerminal   | IfcLightFixtureType      |                     | *      |        |
| M_Troffer Light - Parabolic Rectangular:0600x0600mm(2 Lamp) - 120V | IfcFlowTerminal   | IfcLightFixtureType      |                     | *      |        |
| M_Pendant Light - Linear - 2 Lamp:1200mm - 120V_ 1m Drop           | IfcFlowTerminal   | IfcLightFixtureType      |                     | *      |        |
| M_Downlight - Recessed Can:203mm Incandescent - 120V               | IfcFlowTerminal   | IfcLightFixtureType      |                     | *      |        |
| M_Sconce Light - Sphere:100W - 120V                                | IfcFlowTerminal   | IfcLightFixtureType      | *                   | *      |        |
| M_Pendant Light - Hemisphere:150W - 120V                           | IfcFlowTerminal   | IfcLightFixtureType      | *                   |        |        |
| M_Lighting Switches:Single Pole                                    | IfcFlowTerminal   | IfcLightFixtureType      | *                   | *      | *      |
| M_Lighting Switches:Three Way                                      | IfcFlowTerminal   | IfcLightFixtureType      |                     | *      | *      |
| M_Duplex Receptacle:Standard                                       | IfcFlowTerminal   | IfcOutletType            |                     | *      | *      |
| M_Duplex Receptacle:Duplex Receptacle                              | IfcFlowTerminal   | IfcOutletType            | *                   |        |        |
| M_Duplex Receptacle:GFCI   | IfcFlowTerminal   | IfcOutletType            |                     | *      |        |
| M_Elevator-Hydraulic:2000 lbs                                      | IfcFlowTerminal   | IfcElectricApplianceType |                     | *      |        |
| M_Smoke Detector:Smoke Detector                                    | IfcFlowController | IfcProtectiveDeviceType  | *                   |        |        |

| --- COMPONENT ---   |                               | TYPE                             | BUILDING OCCURRENCE |   |   |
|---|-------------------------------|----------------------------------|---------------------|---|---|
| M_Fire Alarm Control Panel:400x475                        | IfcFlowTerminal               | IfcUnitaryControlElementType     | *                   |   |   |
| M_Microwave:760 x 400 x 450mm                             | IfcFlowTerminal               | IfcElectricApplianceType         | *                   |   |   |
| M_Range:760 x 650mm                                       | IfcFlowTerminal               | IfcElectricApplianceType         | *                   |   |   |
| M_Refrigerator:850 x 760mm                                | IfcFlowTerminal               | IfcElectricApplianceType         | *                   |   |   |
| M_Thermostat:Thermostat                                   | IfcDistributionControlElement | IfcUnitaryControlElementType     | *                   |   |   |
| M_Lighting and Appliance Panelboard - 208V MLO:225 A      | IfcFlowTerminal               | IfcElectricApplianceType         |                     | * | * |
| M_Lighting and Appliance Panelboard - 208V MLO:400 A      | IfcFlowTerminal               | IfcElectricDistributionBoardType | *                   |   |   |
| M_Transformer Switchboard: 914mmx673mm_120                | IfcEnergyConversionDevice     | IfcTransformerType               |                     | * | * |
| M_Telephone Terminal Board:TTB 300x300                    | IfcElectricDistributionBoard  | IfcElectricApplianceType         | *                   |   |   |
| M_Centrifugal Fan - Rooftop - Upblast:991-1905 LPS        | IfcFlowMovingDevice           | IfcFanType                       | *                   | * | * |
| M_Inline Pump – Circulator:3.9 LPS – 0.8 Meter Head       | IfcFlowMovingDevice           | IfcPumpType                      | *                   | * | * |
| M_Hot Water Boiler – 59-440 kW:147kW                      | IfcEnergyConversionDevice     | IfcBoilerType                    | *                   |   |   |
| M_Water Heater:380 L                                      | IfcFlowStorageDevice          | IfcTankType                      |                     | * | * |
| M_Screw Chiller – Air Cooled – 281 – 1231 kW:633 – 703 kW | IfcEnergyConversionDevice     | IfcChillerType                   |                     | * | * |
| M_Air Handling Unit – Split System – Horiz:63300000 J     | IfcFlowMovingDevice           | IfcFanType                       |                     | * | * |

## **Appendix B: Additional Electrical System Properties for Revit Families and Model**

Table B1. Additional electrical system properties of the Revit families.

| Family:Type                     | Revit Category   | Ifc Category – MVD | Attributes<br><i>Pset_ElectricalDeviceCommon</i>   |
|---------------------------------|------------------|--------------------|--|
| M_Lighting Switches:Three Way   | Lighting Devices | IfcSwitchingDevice | RatedCurrent<br>RatedVoltage<br>NominalFrequencyRange<br>PowerFactor<br>ConductorFunction<br>NumberOfPoles<br>HasProtectiveEarth<br>IP_Code<br>InsulationStandardClass |
| M_Lighting Switches:Single Pole |                  |                    |  |

| Family:Type   | Revit Category    | Ifc Category – MVD | Attributes<br><i>Pset_LightFixtureTypeCommon</i> |
|---|-------------------|--------------------|--|
| M_Sconce Light - Sphere:100W - 120V                                     | Lighting Fixtures | IfcLightFixture    | Reference  |
| M_Pendant Light - Hemisphere:150W - 120V                                |                   |                    | Status (instance)                                |
| M_Pendant Light - Linear - 2 Lamp:1200mm - 120V                         |                   |                    | NumberOfSources                                  |
| M_Pendant Light - Linear - 2 Lamp:2400mm - 120V                         |                   |                    | TotalWattage                                     |
| M_Plain Recessed Lighting Fixture:600x1200 - 120                        |                   |                    | LightFixtureMountingType                         |
| M_Plain Recessed Lighting Fixture:600x600 - 120                         |                   |                    | LightFixturePlacingType                          |
| M_Troffer Light - Parabolic Rectangu-<br>lar:0600x1200mm(2 Lamp) - 120V |                   |                    | MaintenaceFactor                                 |
| M_Troffer Light - Parabolic Square:0600x0600mm(2<br>Lamp) - 120V        |                   |                    | SensibleLoadToRadiant                            |
| M_Pendant Light - Linear - 2 Lamp:1200mm - 120V_<br>1m Drop             | Lighting Fixtures | IfcLightFixture    | MaximumPlenumSensibleLoad                        |
| M_Downlight - Recessed Can:203mm Incandescent -<br>120V                 |                   |                    | MaximumSpaceSensibleLoad                         |
|   |                   |                    | <i>Pset_ElectricalDeviceCommon</i>               |
|   |                   |                    | Same as Above                                    |
|   |                   |                    | <i>Pset_LightFixtureTypeSecurityLighting</i>     |
|   |                   |                    | SecurityLightingType                             |
|   |                   |                    | FixtureHeight                                    |
|   |                   |                    | SelfTestFunction                                 |
|   |                   |                    | BackupSupplySystem                               |
|   |                   |                    | PictogramEscapeDirectiom                         |
|   |                   |                    | Addressability                                   |

| Family:Type                      | Revit Category     | Ifc Category – MVD  | Attributes<br><i>Pset_ProtectiveDeviceTypeCommon</i> |
|----------------------------------|--------------------|---------------------|--|
| M_Smoke Detector: Smoke Detector | Fire Alarm Devices | IfcProtectiveDevice | Reference<br>Status (instance)                       |

| Family:Type   | Revit Category       | Ifc Category – MVD           | Attributes<br><i>Pset_ElectricalDeviceCommon</i>  |
|---|----------------------|------------------------------|---|
| M_Fire Alarm Control Panel:400x475                      | Electrical Equipment | IfcElectricDistributionBoard | Same as Above   |
| M_Lighting and Appliance Panelboard - 208V<br>MLO:400 A |                      |                              |   |
| M_Lighting and Appliance Panelboard - 208V<br>MLO:225 A |                      |                              | <i>Pset_ElectricDistributionBoardOccurrence</i>   |
| M_Telephone Terminal Board                              |                      |                              | IsMain<br>IsSkilledOperator<br><i>Pset_ElectricDistributionBoardTypeCommon</i><br>Reference<br>Status |

| Family:Type                               | Revit Category       | Ifc Category – MVD | Attributes<br><i>Pset_ElectricalDeviceCommon</i> |
|---|----------------------|--------------------|--|
| M_Transformer Switchboard:914mmx673mm_120 | Electrical Equipment | IfcTransformer     | Same as Above                                    |

| Family:Type                           | Revit Category      | Ifc Category – MVD | Attributes<br><i>Pset_ElectricalDeviceCommon</i>                         |
|---------------------------------------|---------------------|--------------------|--|
| M_Duplex Receptacle:Standard          | Electrical Fixtures | IfcOutlet          | Same as Above  |
| M_Duplex Receptacle:GFCI              |                     |                    |  |
| M_Duplex Receptacle:Duplex Receptacle |                     |                    | <i>Pset_OutletTypeCommon</i><br>Reference<br>Status<br>IsPluggableOutlet |

| Family:Type                   | Revit Category      | Ifc Category – MVD     | Attributes<br><i>Pset_ElectricalDeviceCommon</i> |
|-------------------------------|---------------------|------------------------|--|
| M_Microwave:760 x 400 x 450mm | Electrical Fixtures | IfcDistributionElement | Same as Above                                    |
| M_Range:760 x 650mm           |                     |                        |  |
| M_Refrigerator:850 x 760mm    |                     |                        |  |
| M_Thermostat:Thermostat       |                     |                        |  |

| Family:Type  | Revit Category       | Ifc Category – MVD | Attributes<br><i>Pset_ElectricalDeviceCommon</i> |
|--|----------------------|--------------------|--|
| M_Centrifugal Fan - Rooftop - Upblast:991-1905 LPS | Mechanical Equipment | IfcElectricMotor   | Same as Above                                    |

| Family:Type   | Revit Category       | Ifc Category – MVD | Attributes<br><i>Pset_ElectricalDeviceCommon</i> |
|---|----------------------|--------------------|--|
| M_Inline Pump – Circulator:3.9 LPS – 0.8 Meter Head | Mechanical Equipment | IfcPump            | Same as Above                                    |

| Family:Type                          | Revit Category       | Ifc Category – MVD | Attributes<br><i>Pset_BoilerPHistory</i>  |
|--------------------------------------|----------------------|--------------------|---|
| M_Hot Water Boiler – 59-440 kW:147kW | Mechanical Equipment | IfcBoiler          | EnergySourceConsumption<br>OperationalEfficiency<br>CombustionEfficiency<br>WorkingPressure<br>CombustionTemperature<br>PartLoadRatio<br>Load<br>PrimaryEnergyConsumption<br>AuxiliaryEnergyConsumption |
|                                      |                      |                    | <i>Pset_BoilerTypeCommon</i>  |



| Family:Type                                   | Revit Category                   | Ifc Category – MVD    | Attributes<br><i>Pset_BoilerPHistory</i>   |
|---|----------------------------------|-----------------------|--|
| M_Hot Water Boiler – 59-440 kW:147kW (cont'd) | Mechanical Equipment<br>(cont'd) | IfcBoiler<br>(cont'd) | Status<br>PressureRating<br>OperatingMode<br>HeatTransferSurfaceArea<br>NominalPartLoadRatio<br>WaterInletTemperatureRange<br>WaterStorageCapacity<br><br>IsWaterStorageHeater<br>PartialLoadEfficiencyCurves<br>OutletTemperatureRange<br>NominalEnergyConsumption<br>EnergySource<br><i>Pset_BoilerTypeWater</i> |
|   |                                  |                       | NominalEfficiency<br>HeatOutput  |

| Family:Type           | Revit Category       | Ifc Category – MVD | Attributes<br><i>Pset_BoilerPHistory</i> |
|-----------------------|----------------------|--------------------|--|
| M_ Water Heater:380 L | Mechanical Equipment | IfcBoiler          | Same as Above                            |
|                       |                      |                    | <i>Pset_BoilerTypeCommon</i>             |
|                       |                      |                    | Same as Above                            |
|                       |                      |                    | <i>Pset_BoilerTypeWater</i>              |
|                       |                      |                    | Same as Above                            |

| Family:Type   | Revit Category       | Ifc Category – MVD | Attributes<br><i>Pset_ElectricalDeviceCommon</i> |
|---|----------------------|--------------------|--|
| M_Screw Chiller – Air Cooled – 281-1231 kW:633-703 kW | Mechanical Equipment | IfcChiller         | Same as Above                                    |

| Family:Type   | Revit Category       | Ifc Category - MVD  | Attributes<br><i>Pset_ElectricalDeviceCommon</i> |
|---|----------------------|---------------------|--|
| M_Air Handling Unit – Split System – Horiz:63300000 J | Mechanical Equipment | IfcUnitaryEquipment | Same as Above                                    |

Table B2. Additional project properties not associated with individual elements.

| Revit Category | Ifc Category - MVD | Attributes<br><i>Pset_BuildingCommon</i> |
|----------------|--------------------|--|
| N/A            | <i>IfcBuilding</i> | Reference                                |
|                |                    | BuildingID                               |
|                |                    | IsPermanentID                            |
|                |                    | ConstructionMethod                       |
|                |                    | FireProtectionClass                      |
|                |                    | SprinklerProtection                      |
|                |                    | SprinklerProtectionAutomatic             |
|                |                    | OccupancyType                            |
|                |                    | GrossPlannedArea                         |
|                |                    | NetPlannedArea                           |
|                |                    | NumberOfStoreys                          |
|                |                    | YearOfConstruction                       |
|                |                    | YearOfLastRefurbishment                  |
|                |                    | IsLandmarked                             |

## Appendix C: Sample Validation Report

Table C1. Electrical system exchanges.

| Number | Exchange Name                          |
|--------|--|
| 1      | Facility Occupancy Model               |
| 2      | Electrical Project Requirements        |
| 3      | Equipment Room Requirements            |
| 4      | Space Program                          |
| 5      | Coordinate Concept Design              |
| 6      | Electrical System Types                |
| 7      | Electrical Basis of Design             |
| 8      | Electrical Source of Supply            |
| 9      | Electrical Space Requirements          |
| 10     | Energy Performance                     |
| 11     | Document Concept Design                |
| 12     | Locate Electrical Loads                |
| 13     | Electrical Equipment Requirements      |
| 14     | Electrical Equipment Rooms             |
| 15     | Lighting Layout                        |
| 16     | Size Electrical System                 |
| 17     | Raceway Layout                         |
| 18     | Electrical Schematic Design            |
| 19     | Coordinate with Other Building Systems |
| 20     | Estimate Energy Usage                  |
| 21     | Facility Spatial Configuration         |
| 22     | Electrical Supply Requirements         |
| 23     | System Loads                           |
| 24     | Cabling Schematic                      |
| 25     | Redistribute Circuits                  |
| 26     | Cabling and Equipment Size             |
| 27     | Architectural Light Fixtures           |
| 28     | Product Type Specifications            |
| 29     | Document Coordinated Design            |

Table C2. Validation test results symbols used in Table C-3.

| Symbol    | Meaning   | Flag Column  |
|-----------|---|--|
| -         | The test was inapplicable for the particular exchange   | A “-” indicates that the test does not apply to any of the exchanges                     |
| +         | The entity or concept passed the test for the given exchange  | A “+” indicates that the test passes for all applicable exchanges                        |
| *         | An optional rule for the particular exchange failed the test  | An “*” indicates that the optional test failed at least one of the applicable exchanges  |
| F         | A mandatory rule for the particular exchange failed the test  | An “F” indicates that the mandatory test failed at least one of the applicable exchanges |
| R         | Required concept (Req column)   |  |
| O         | Optional concept (Req column)   |  |
| #<number> | The number identifies the first object instance that violates the rule – the numbers correspond to those in the IFC file. (Errors column) |  |
| <number>  | Number of instances subject to the rule (Count column)  |  |

### Table C3. Clinic Electrical System MVD IFC Validation.

[illegible]









[illegible]

[illegible]



[illegible]

[illegible]

[illegible]

[illegible]

| Entity/Concept   | Req | Errors | Count | Flag | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 |
|--|-----|--------|-------|------|---|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| PredefinedType=RESIDUALCURRENTCIRCUITBREAKER;Name=Pset_ProtectiveDeviceTypeResidualCurrentCircuitBreaker;TemplateType=PSET_TYPEDRIVENOVERRIDE; |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=RESIDUALCURRENTSWITCH;Name=Pset_ProtectiveDeviceTypeResidualCurrentSwitch;TemplateType=PSET_TYPEDRIVENOVERRIDE;                 |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=VARISTOR;Name=Pset_ProtectiveDeviceTypeVaristor;TemplateType=PSET_TYPEDRIVENOVERRIDE;   |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Ports [IFC4]   | -   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Name=Line;Type=ELECTRICAL;Flow=SINK  |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Name=Load;Type=ELECTRICAL;Flow=SOURCE  |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Spatial Containment  | -   |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| IfcCableCarrierSegment   |     |        | 0     |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Identity   | -   |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Object Typing  | -   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Type=IfcCableCarrierSegmentType;   |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Property Sets  | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| PredefinedType=CABLELADDERSEGMENT;Name=Pset_CableCarrierSegmentTypeCableLadderSegment;   |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  |
| PredefinedType=CABLETRAYSEGMENT;Name=Pset_CableCarrierSegmentTypeCableTraySegment;TemplateType=PSET_TYPEDRIVENOVERRIDE;                        |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  |



| Entity/Concept   | Req | Errors | Count | Flag | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 |
|--|-----|--------|-------|------|---|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| PredefinedType=CABLETRUNKINGS<br>EGMENT;Name=Pset_CableCarrierSegmentTypeCableTrunkingSegment;TemplateType=PSET_TYPEDRIVENOVER<br>VERRIDE; |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  |
| Name=Pset_CableCarrierSegmentTypeCommon;TemplateType=PSET_TYPEDRIVENOVER<br>VERRIDE;   |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  |
| PredefinedType=CONDUITSEGMENT<br>;Name=Pset_CableCarrierSegmentTypeConduitSegment;   |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  |
| Material Profile Set Usage [IFC4]  | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Name=Casing;Profile=IfcArbitraryClosedProfileDef;  |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  |
| Product Placement  | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Type=IfcLocalPlacement;  |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Axis Geometry  | R   |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Body Geometry  | R   |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Spatial Containment  | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Structure=IfcSite;   |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | +  | +  | +  | -  | -  | -  | -  | +  | -  | +  | -  | -  | -  |
| Structure=IfcBuildingStorey;   |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | +  | +  | +  | -  | -  | -  | -  | +  | -  | +  | -  | -  | -  |
| Interference   | R   |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | -  | -  | -  |
| Ports [IFC4]   | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Name=Head;Type=NOTDEFINED;Flow=SINK  |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | -  | +  | -  | +  | -  | -  | +  |
| Name=Tail;Type=NOTDEFINED;Flow=SOURCE  |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | -  | +  | -  | +  | -  | -  | +  |
| IfcSpace   |     |        | 266   |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Identity   | R   |        | 266   | +    | - | + | + | + | + | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Object Typing  | O   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Type=IfcSpaceType;   |     | #275   | 0     | *    | - | - | - | * | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Property Sets  | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |







| Entity/Concept   | Req | Errors | Count | Flag | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 |
|--|-----|--------|-------|------|---|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Structure=IfcBuildingStorey;                             |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| IfcGrid  |     |        | 0     |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Identity   | -   |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |    |
| Product Placement  | -   |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Grid   | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| GridType=RECTANGULAR;UCurve=IfcLine;VCurve=IfcLine;      |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| IfcWallElementedCase                                     |     |        | 0     |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Identity   | -   |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Product Placement  | R   |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | +  | -  | -  | -  | -  | -  | +  | -  | -  | -  | +  | -  | -  | -  | -  | -  | -  | -  | +  |
| Axis Geometry  | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| RepresentationType=Curve2D;Geometry=IfcBoundedCurve;     |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | +  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  |
| Surface Geometry   | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| RepresentationType=Surface3D;Geometry=IfcBoundedSurface; |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | +  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  |
| Spatial Containment                                      | -   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Structure=IfcSite;                                       |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Structure=IfcBuildingStorey;                             |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Structure=IfcBuildingStorey;                             |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Object Aggregation                                       | -   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| PredefinedType=;RelatedObjects=IfcMember;                |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=;RelatedObjects=IfcPlate;                 |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=;RelatedObjects=IfcBuildingElementPart;   |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=;RelatedObjects=IfcBeam;                  |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| IfcSlabElementedCase                                     |     |        | 0     |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |

[illegible]

[illegible]





[illegible]

[illegible]



| Entity/Concept   | Req | Errors | Count | Flag | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 |
|--|-----|--------|-------|------|---|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Body Geometry  | -   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| RepresentationType=Brep;Geometry=IfcFacetedBrep;                     |     |        | 2089  | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| RepresentationType=SurfaceModel;Geometry=IfcFaceBasedSurfaceModel;   |     |        | 2089  | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| RepresentationType=SweptSolid;Geometry=IfcExtrudedAreaSolid;         |     |        | 2089  | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| RepresentationType=SectionedSpine;Geometry=IfcSectionedSpine;        |     |        | 2089  | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| RepresentationType=CSG;Geometry=IfcCsgSolid;                         |     |        | 2089  | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| RepresentationType=Tessellation;Geometry=IfcTriangulatedFaceSet;     |     |        | 2089  | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| RepresentationType=MappedRepresentation;Geometry=IfcMappedItem;      |     |        | 2089  | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| IfcFlowMeter   |     |        | 0     |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Identity   | -   |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Object Typing  | -   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Type=IfcFlowMeterType;   |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Property Sets  | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| PredefinedType=;Name=Pset_FlowMeterOccurrence;                       |     |        | 0     | +    | - | - | - | - | - | - | - | + | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Name=Pset_FlowMeterTypeCommon;TemplateType=PSET_TYPEDRIVEN_OVERRIDE; |     |        | 0     | +    | - | - | - | - | - | - | - | + | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=ENERGYMETER;Name=Pset_FlowMeterTypeEnergyMeter;       |     |        | 0     | +    | - | - | - | - | - | - | - | + | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Ports [IFC4]   | R   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| PredefinedType=ENERGYMETER;Name=Inlet;Type=ELECTRICAL;Flow=SI_NK     |     |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | -  | +  |





| Entity/Concept  | Req | Errors  | Count | Flag | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 |
|---|-----|---------|-------|------|---|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Property Sets for Types                                     | R   | #227466 | 0     | F    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | F  | F  |    |
| IfcFlowMeterType  |     |         | 0     |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Identity  | R   |         | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | +  |    |    |
| Property Sets for Types                                     | R   |         | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | +  |    |
| IfcChillerType  |     |         | 1     |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Identity  | R   |         | 1     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | +  |    |
| Property Sets for Types                                     | R   | #247646 | 0     | F    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | F  | F  |    |
| IfcCableCarrierFitting                                      |     |         | 0     |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Identity  | -   |         | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |    |
| Object Typing   | -   |         |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Type=IfcCableCarrierFittingType;                            |     |         | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |    |
| Property Sets   | R   |         |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| PredefinedType=;Name=Pset_CableCarrierFittingTypeCommon;    |     |         | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  |    |
| Ports [IFC4]  | R   |         |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| PredefinedType=BEND;Name=Head;Type=NOTDEFINED;Flow=SINK     |     |         | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | +  | -  | +  | -  | -  | -  | +  |    |
| PredefinedType=BEND;Name=Tail;Type=NOTDEFINED;Flow=SOURCE   |     |         | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | +  | -  | +  | -  | -  | -  | +  |    |
| PredefinedType=CROSS;Name=Head;Type=NOTDEFINED;Flow=SINK    |     |         | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | +  | -  | +  | -  | -  | -  | +  |    |
| PredefinedType=CROSS;Name=Tail;Type=NOTDEFINED;Flow=SOURCE  |     |         | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | +  | -  | +  | -  | -  | -  | +  |    |
| PredefinedType=CROSS;Name=Left;Type=NOTDEFINED;Flow=SOURCE  |     |         | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | +  | -  | +  | -  | -  | -  | +  |    |
| PredefinedType=CROSS;Name=Right;Type=NOTDEFINED;Flow=SOURCE |     |         | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | +  | -  | +  | -  | -  | -  | +  |    |
| PredefinedType=REDUCER;Name=Head;Type=NOTDEFINED;Flow=SINK  |     |         | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | +  | -  | -  | -  | -  | -  | +  | -  | +  | -  | -  | -  | +  |    |

[illegible]







[illegible]

| Entity/Concept   | Req | Errors | Count | Flag | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 |
|--|-----|--------|-------|------|---|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| PredefinedType=DATA;Name=Gang#1;Type=DATA;Flow=SOURCE        |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=DATA;Name=Gang#2;Type=DATA;Flow=SOURCE        |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=POWER;Name=Line;Type=ELECTRICAL;Flow=SINK     |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=POWER;Name=Load;Type=ELECTRICAL;Flow=SOURCE   |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=POWER;Name=Gang#1;Type=ELECTRICAL;Flow=SOURCE |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=POWER;Name=Gang#2;Type=ELECTRICAL;Flow=SOURCE |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=POWER;Name=Gang#3;Type=ELECTRICAL;Flow=SOURCE |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| PredefinedType=POWER;Name=Gang#4;Type=ELECTRICAL;Flow=SOURCE |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| lfcElectricMotorType   |     |        | 0     |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Identity   | R   |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | +  |
| Property Sets for Types                                      | R   |        | 0     | +    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | +  | +  |
| Ports [IFC4]   | -   |        |       |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |
| Name=Line;Type=ELECTRICAL;Flow=SINK                          |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Name=Drive;Type=NOTDEFINED;Flow=SOURCE                       |     |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Footprint Geometry   | -   |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Body Geometry  | -   |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| Clearance Geometry   | -   |        | 0     | -    | - | - | - | - | - | - | - | - | - | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  | -  |
| lfcElectricGeneratorType                                     |     |        | 0     |      |   |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |



| Entity/Concept   | Req | Errors | Count | Flag | 1    | 2    | 3   | 4   | 5   | 6    | 7    | 8   | 9   | 10   | 11  | 12   | 13   | 14   | 15  | 16   | 17   | 18   | 19   | 20   | 21   | 22   | 23   | 24   | 25   | 26   | 27  | 28  | 29  |
|--|-----|--------|-------|------|------|------|-----|-----|-----|------|------|-----|-----|------|-----|------|------|------|-----|------|------|------|------|------|------|------|------|------|------|------|-----|-----|-----|
| Name=Insulation;Profile=IfcCircleHollowProfileDef;     |     |        | 0     | +    | -    | -    | -   | -   | -   | -    | -    | -   | -   | -    | -   | -    | -    | -    | -   | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | +   | +   |     |
| Name=Screen;Profile=IfcCircleHollowProfileDef;         |     |        | 0     | +    | -    | -    | -   | -   | -   | -    | -    | -   | -   | -    | -   | -    | -    | -    | -   | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | +   | +   |     |
| Name=Sheath;Profile=IfcCircleHollowProfileDef;         |     |        | 0     | +    | -    | -    | -   | -   | -   | -    | -    | -   | -   | -    | -   | -    | -    | -    | -   | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | +   | +   |     |
| Ports [IFC4]   | -   |        |       |      |      |      |     |     |     |      |      |     |     |      |     |      |      |      |     |      |      |      |      |      |      |      |      |      |      |      |     |     |     |
| PredefinedType=;Name=Head;Flow=Sink;Type=ELECTRICAL;   |     |        | 0     | -    | -    | -    | -   | -   | -   | -    | -    | -   | -   | -    | -   | -    | -    | -    | -   | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -   | -   |     |
| PredefinedType=;Name=Tail;Flow=Source;Type=ELECTRICAL; |     |        | 0     | -    | -    | -    | -   | -   | -   | -    | -    | -   | -   | -    | -   | -    | -    | -    | -   | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -   | -   |     |
| IfcTransportElementType                                |     |        | 0     |      |      |      |     |     |     |      |      |     |     |      |     |      |      |      |     |      |      |      |      |      |      |      |      |      |      |      |     |     |     |
| Identity   | -   |        | 0     | -    | -    | -    | -   | -   | -   | -    | -    | -   | -   | -    | -   | -    | -    | -    | -   | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -   | -   |     |
| Property Sets for Types                                | -   |        | 0     | -    | -    | -    | -   | -   | -   | -    | -    | -   | -   | -    | -   | -    | -    | -    | -   | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -   | -   |     |
| Product Type Assignment                                | -   |        | 0     | -    | -    | -    | -   | -   | -   | -    | -    | -   | -   | -    | -   | -    | -    | -    | -   | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -    | -   | -   |     |
| SUMMARY FOR IFC4                                       |     |        |       |      | 99%  | 99%  | 98% | 97% | 99% | 99%  | 99%  | 99% | 99% | 99%  | 99% | 99%  | 99%  | 99%  | 99% | 99%  | 99%  | 99%  | 99%  | 99%  | 99%  | 99%  | 99%  | 99%  | 99%  | 99%  | 99% | 99% | 99% |
| SUMMARY FOR IFC2X3                                     |     |        |       |      | 100% | 100% | 99% | 99% | 99% | 100% | 100% | 99% | 99% | 100% | 99% | 100% | 100% | 100% | 99% | 100% | 100% | 100% | 100% | 100% | 100% | 100% | 100% | 100% | 100% | 100% | 99% | 99% | 99% |

**Table C4. Summary of Electrical System MVD IFC Validation.**

[illegible]

[illegible]



|  |                                    |  |  |                                     |
|--|------------------------------------|--|--|-------------------------------------|
| <b>REPORT DOCUMENTATION PAGE</b>   |                                    |  | Form Approved<br>OMB No. 0704-0188               |                                     |
| Public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing this collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden to Department of Defense, Washington Headquarters Services, Directorate for Information Operations and Reports (0704-0188), 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302. Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number. <b>PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ADDRESS.</b>  |                                    |  |  |                                     |
| <b>1. REPORT DATE (DD-MM-YYYY)</b><br>June 2013  |                                    | <b>2. REPORT TYPE</b><br>Final                                     |  | <b>3. DATES COVERED (From - To)</b> |
| <b>4. TITLE AND SUBTITLE</b><br>Ontology for Life-Cycle Modeling of Electrical Distribution Systems: Application of Model View Definition Attributes   |                                    | <b>5a. CONTRACT NUMBER</b><br>CRADA-07-CERL-02                     |  |                                     |
|  |                                    | <b>5b. GRANT NUMBER</b>  |  |                                     |
|  |                                    | <b>5c. PROGRAM ELEMENT NUMBER</b><br>622784 T41                    |  |                                     |
| <b>6. AUTHOR(S)</b><br>Kristine K. Fallon, Robert A. Feldman, Gregory Williams, and Omobolawa Fadojutimi, and Tim Chipman  |                                    | <b>5d. PROJECT NUMBER</b>  |  |                                     |
|  |                                    | <b>5e. TASK NUMBER</b>   |  |                                     |
|  |                                    | <b>5f. WORK UNIT NUMBER</b>  |  |                                     |
| <b>7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES)</b><br>Kristine Fallon Associates, Inc.<br>11 E. Adams Street, Suite 1100<br>Chicago, IL 60603   |                                    | <b>8. PERFORMING ORGANIZATION REPORT NUMBER</b>                    |  |                                     |
| <b>9. SPONSORING / MONITORING AGENCY NAME(S) AND ADDRESS(ES)</b><br>US Army Engineer Research and Development Center<br>Construction Engineering Research Laboratory<br>P.O. Box 9005<br>Champaign, IL 61826-9005  |                                    | <b>10. SPONSOR/MONITOR'S ACRONYM(S)</b><br>ERDC-CERL               |  |                                     |
|  |                                    | <b>11. SPONSOR/MONITOR'S REPORT NUMBER(S)</b><br>ERDC/CERL CR-13-3 |  |                                     |
| <b>12. DISTRIBUTION / AVAILABILITY STATEMENT</b><br>Approved for public release; distribution is unlimited.  |                                    |  |  |                                     |
| <b>13. SUPPLEMENTARY NOTES</b>   |                                    |  |  |                                     |
| <b>14. ABSTRACT</b><br><p>Previous efforts by the US Army Engineer Research and Development Center, Construction Engineering Research Laboratory (ERDC-CERL) to develop a life-cycle building model have resulted in the definition of a "core" building information model that contains general information describing facility assets such as spaces and equipment. To describe how facility assets (i.e., components) function together, information about assemblies of assets and their connections must also be defined. The definitions of assets, assemblies, and connections for the various building-information domains are discipline-specific. Work documented in ERDC/CERL CR-13-2 identified the processes and tasks specifically associated with the design of building electrical systems and the information exchange requirements for every participant in the design. The findings were used to develop an information-exchange Model View Definition (MVD) for building electrical systems.</p> <p>The objective of the current work was to document the steps needed to identify the electrical MVD attributes in three experimental building information models representing typical low-rise Army facilities, and to update the models. This work also validated the International Foundation Class (IFC) export function from the experimental models against the electrical MVD, and studied the requirements for creating computable open building models that can be utilized for the automated information exchanges.</p> |                                    |  |  |                                     |
| <b>15. SUBJECT TERMS</b><br>information exchange, electrical systems, product data templates, guide specifications, Construction Operations Building information exchange (COBie), Building Information Modeling (BIM)   |                                    |  |  |                                     |
| <b>16. SECURITY CLASSIFICATION OF:</b>   |                                    |  | <b>17. LIMITATION OF ABSTRACT</b>                | <b>18. NUMBER OF PAGES</b>          |
| <b>a. REPORT</b><br>Unclassified   | <b>b. ABSTRACT</b><br>Unclassified | <b>c. THIS PAGE</b><br>Unclassified                                |  | 70                                  |
|  |                                    |  | <b>19a. NAME OF RESPONSIBLE PERSON</b>           |                                     |
|  |                                    |  | <b>19b. TELEPHONE NUMBER (include area code)</b> |                                     |